

# Alber™ Battery Capacity Tester Integrated System



## Rack Mount Guide


### 1. Attaching the brackets

Remove the four screws (two per side) from the Vertiv™ Alber Battery Capacity Tester Integrated (BCTI) unit. Use the supplied screws to mount the brackets to either side of the BCTI unit as shown in the illustration.

### 2. Attaching the assembly to the rack

**NOTE:** Determine a rack position that allows the cables of the BCTI unit to reach their terminating points on other battery capacity test equipment.

If appropriate, pre-install any cage nuts or other hardware needed to attach the assembly to your particular brand of rack. Using four screws (two per side), attach the ends of the brackets to the rack uprights.

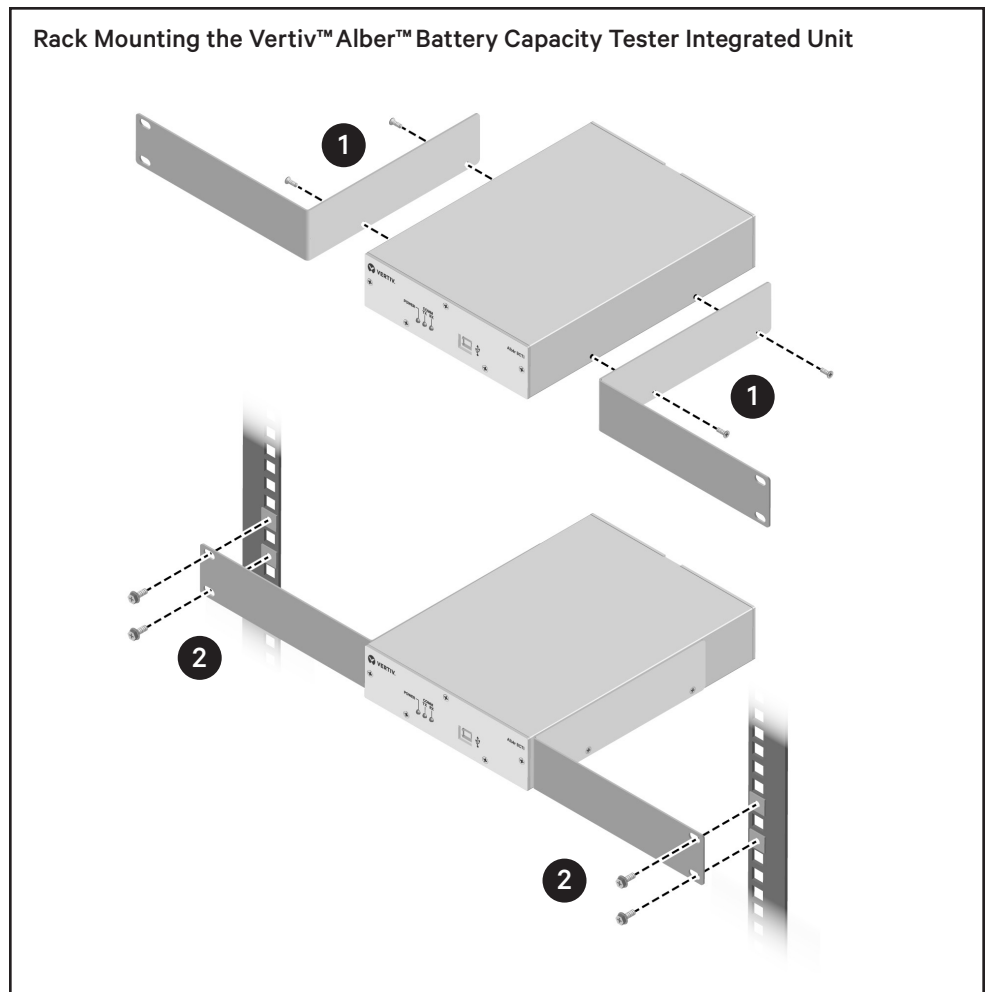



**To contact Vertiv Technical Support: visit [www.Vertiv.com](http://www.Vertiv.com)**

© 2022 Vertiv Group Corp. All rights reserved. Vertiv™ and the Vertiv logo are trademarks or registered trademarks of Vertiv Group Corp. All other names and logos referred to are trade names, trademarks or registered trademarks of their respective owners. While every precaution has been taken to ensure accuracy and completeness here, Vertiv Group Corp. assumes no responsibility, and disclaims all liability, for damages resulting from use of this information or for any errors or omissions. Specifications, rebates and other promotional offers are subject to change at Vertiv's sole discretion upon notice.

